

ATTACHMENT 2

AUTHORIZATION TO OPERATE (ATO)
UNDER GENERAL AIR QUALITY CONTROL PERMIT FOR NSPS GENERATORS/ ENGINES
 (As required by Title 49, Chapter 3, Article 2, Section 49-480, Arizona Revised Statutes)

I. FACILITY INFORMATION:

Business Name: US AIR FORCE RESERVE
 Facility Name: POWER GENERATION SHELTER (PGS)
 Responsible Official: TSGT BRAD HOVEY
 Contact: TSGT BRAD HOVEY (520) 228-0661
 Source Location: DAVIS MONTHAN AFB, SOUTH OF BUILDING 74,
 DAVIS MONTHAN AFB, AZ 85707

II. AUTHORIZED EQUIPMENT: EMERGENCY

ATO #	Manufacturer	Model #	Serial Number/ ID number	Maximum Rated Capacity (HP)	Allowable Hours of Operation ¹	Model year/ Applicability Date ²	Allowable Fuel(s)
6092-1	KOHLER	800REOZMB	2251864	1207	100	05-6-2009	Diesel
6092-2	KOHLER	800REOZMB	2251865	1207	100	05-7-2009	Diesel
6092-3	KOHLER	800REOZMB	2251867	1207	100	05-8-2009	Diesel

¹Allowable hours of operation for emergency generators are limited to maintenance testing and readiness checks. There is no limit on hours of operation during true emergencies.

²The most recent date of order, manufacture, reconstruction, or modification.



SIGNATURE

October 16, 2013
 ATO ISSUE DATE

June 30, 2018
 EXPIRATION DATE


Mukonde Chama, P.E., Air Permits Manager, PDEQ
 TITLE

AUTHORIZATION TO OPERATE (ATO)
 UNDER GENERAL AIR QUALITY CONTROL PERMIT FOR NSPS GENERATORS/ ENGINES
 (As required by Title 49, Chapter 3, Article 2, Section 49-480, Arizona Revised Statutes)

III. SUPPLEMENTAL REQUIREMENTS

The following requirements apply in addition to the *Specific Conditions, Attachment 1 and Attachment 2*:

ATO #	Applicable NSPS Attachment(s)	NO _x (g/hphr)	NMHC (g/hphr)	NMHC+NO _x (g/hphr)	CO (g/hphr)	PM (g/hphr)	Certified Emissions Life (term, date)
6092	Attachment 5 Post Model 2007	-	-	4.8	2.6	0.15	8000 Hours or 10 Years, whichever comes first.

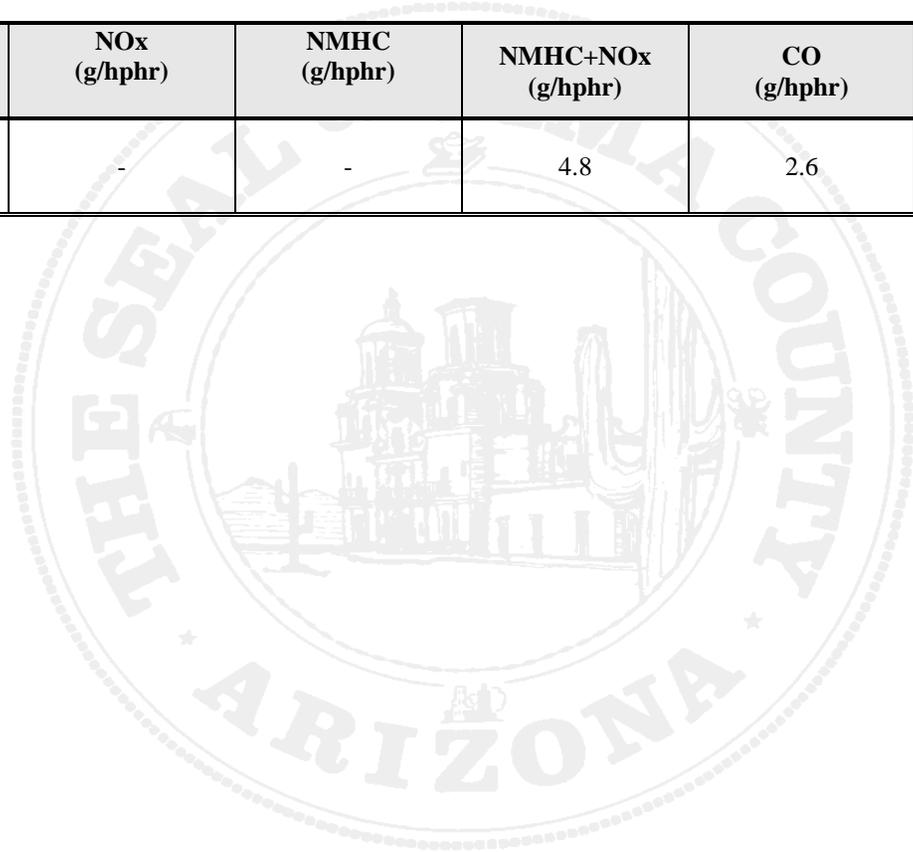

SIGNATURE

October 16, 2013

ATO ISSUE DATE

June 30, 2018
 EXPIRATION DATE

Mukonde Chama, P.E., Air Permits Manager, PDEQ
 TITLE